



## JOINT SERVICE TRENCH TYPICAL : WITH GAS

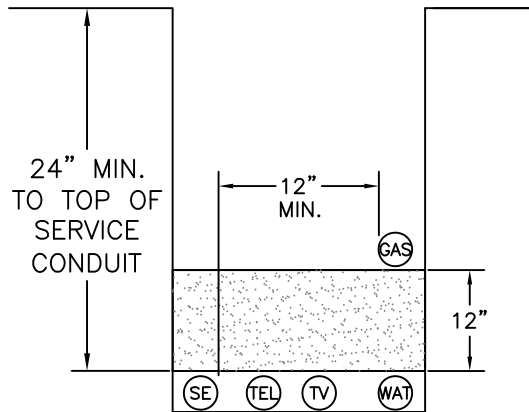

**MAINTAIN 12" HORIZONTAL SEPERATION  
& 12" VERTICAL SEPERATION BETWEEN  
GAS & SE CONDUIT**

## CLEARANCE BETWEEN ELECTRICAL METER BASE AND GAS METER (OR OTHER OBSTRUCTIONS)

UNDERGROUND/OVERHEAD RESIDENTIAL SERVICES

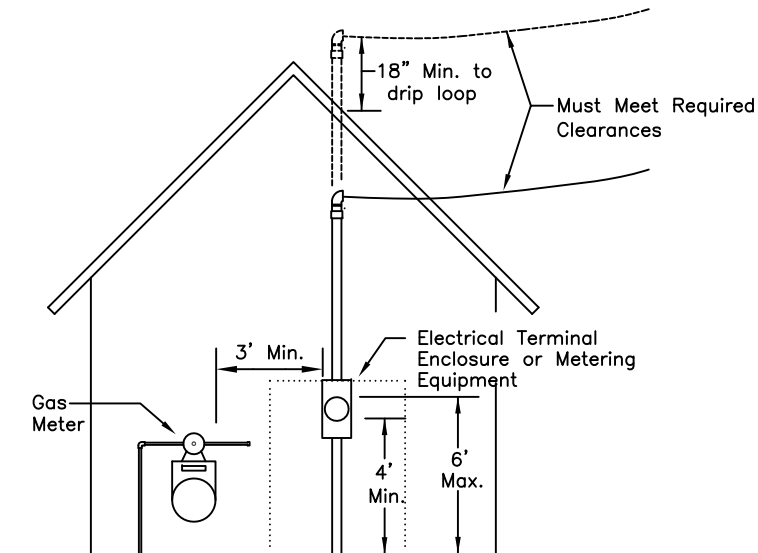


NEC Requires Clear Working Space of  
75" High x 36" Wide x 36" in Front

3-foot minimum clear working space required between  
electric meter and gas meter.


## UNDERGROUND SERVICE

SERVICE DETAIL  
SINGLE FAMILY DWELLING  
CUSTOMER SUPPLIED TRENCH AND CONDUIT

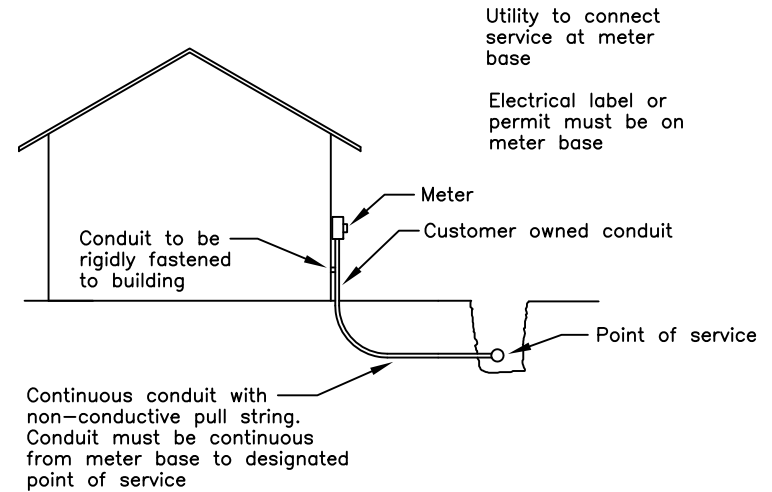

SIDE VIEW

NOTE: FOR 200 AMP RESIDENTIAL  
SERVICES USE 3" PVC

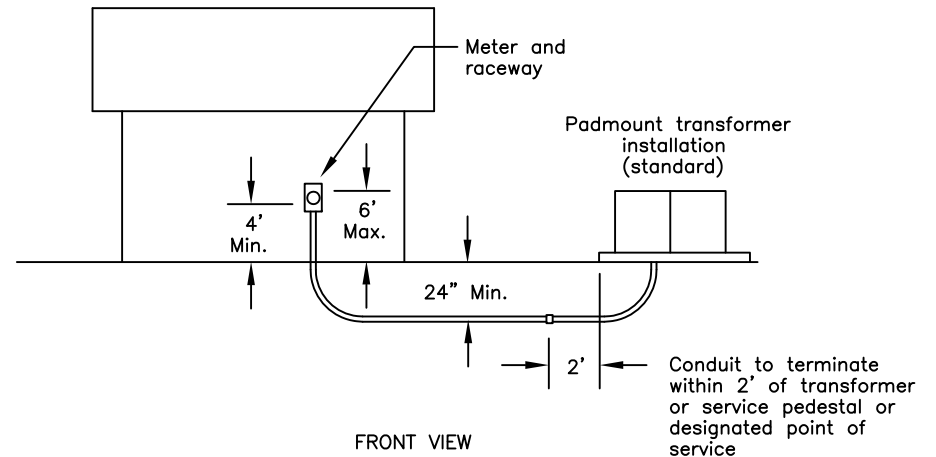

FRONT VIEW



**Salem Electric**  
SERVING KEIZER AND SALEM  
633 SEVENTH STREET NW  
PO BOX 5588  
SALEM, OR 97304-0055  
503-362-3601